


CO₂ Component Description

Pressure Operated Switch

Effective: November 2003

K-81-5180

P/N: 486536

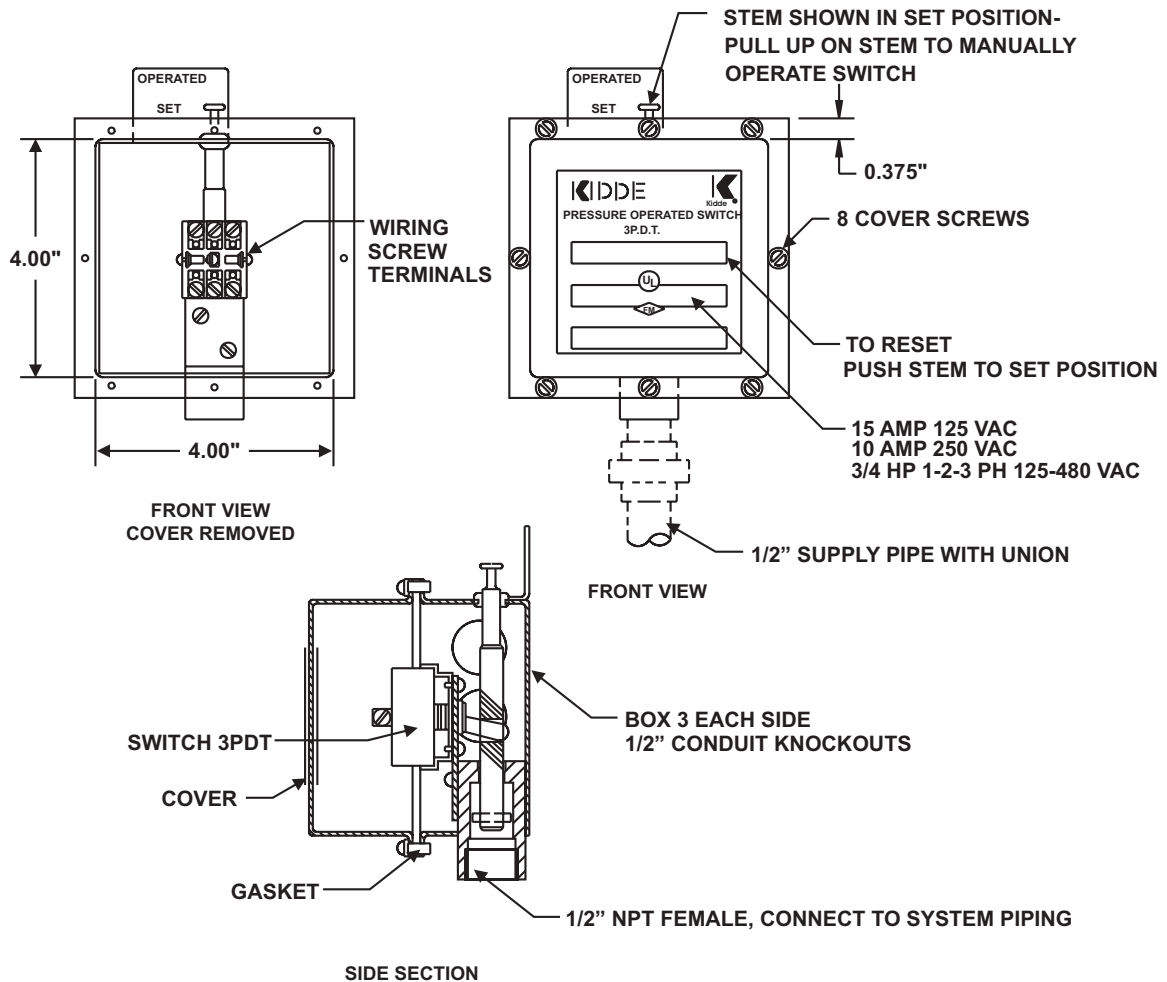

NOTES:

- The switch may be mounted in any position, however, the preferred installation is upright, as shown.
- Any load connection to the switch must not exceed the switch rating, and shall utilize a suitable protection device (i.e., circuit breaker, fuse).
- Contact Ratings (3 PDT):
 - 15 Amp @ 125 Vac
 - 10 Amp @ 250 Vac
 - 3/4 HP @ 250 Vac
 - 1, 2 or 3 Phase

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL INC., Ashland, MA 01721. Telephone: (508) 881-2000