

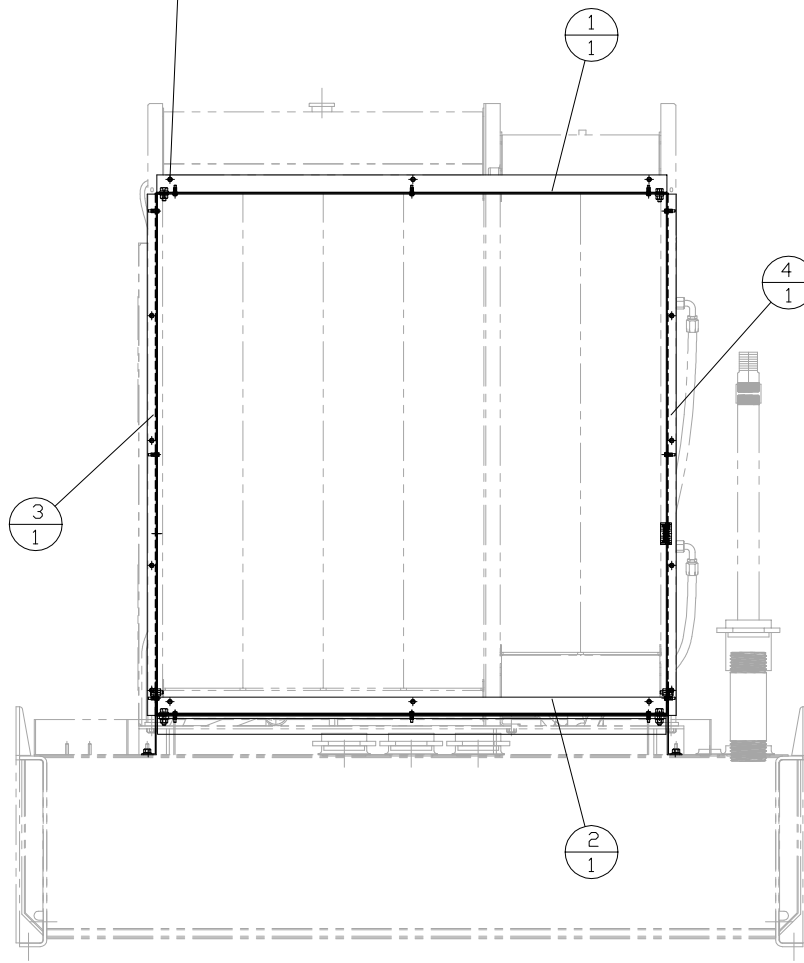


REMOVE EXISTING CAT RADIATOR FLANGE AND DISCARD.
INSTALL DISCHARGE DUCT ASSEMBLY (87D210-1)
USING THE EXISTING HARDWARE

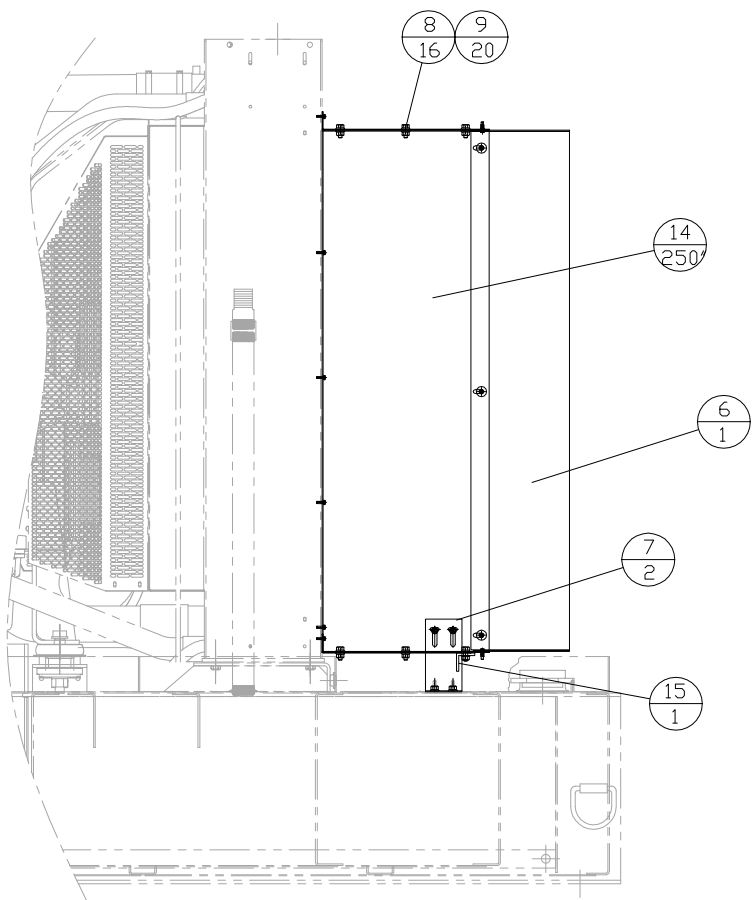

ITEM	QTY.	PART NO.	DESCRIPTION	WEIGHT
1	1	87D211-1	DUCT - TOP	34
2	1	87D212-1	DUCT - BOTTOM	34
3	1	87D213-1	DUCT - LEFT SIDE	34
4	1	87D214-1	DUCT - RIGHT SIDE	34
5	2	87D215-1	DUCT - FLASHING (TOP/BOTTOM)	36
6	2	87D216-1	DUCT - FLASHING (LEFT/RIGHT)	38
7	2	87D217-1	DUCT - SUPPORT	2
8	16	345-8531	3/8"-16x1" FLANGED BOLT	XX
9	20	198-2970	3/8"-16 FLANGED NUT	XX
10	12	97646A115	1/4"-20x1" S.S. FLANGED BOLT	XX
11	12	317-5700	1/4" S.S. NEOPREME WASHER	XX
12	1	ECHA24112	1-1/2" FEMALE OZ BUSHING	XX
13	1	ECHA1112	1-1/2" MALE OZ BUSHING	XX
14	250'	3E6697	SEAL - BULB	XX
15	1	87D218	DUCT - STIFFENER	2
TOTAL				214

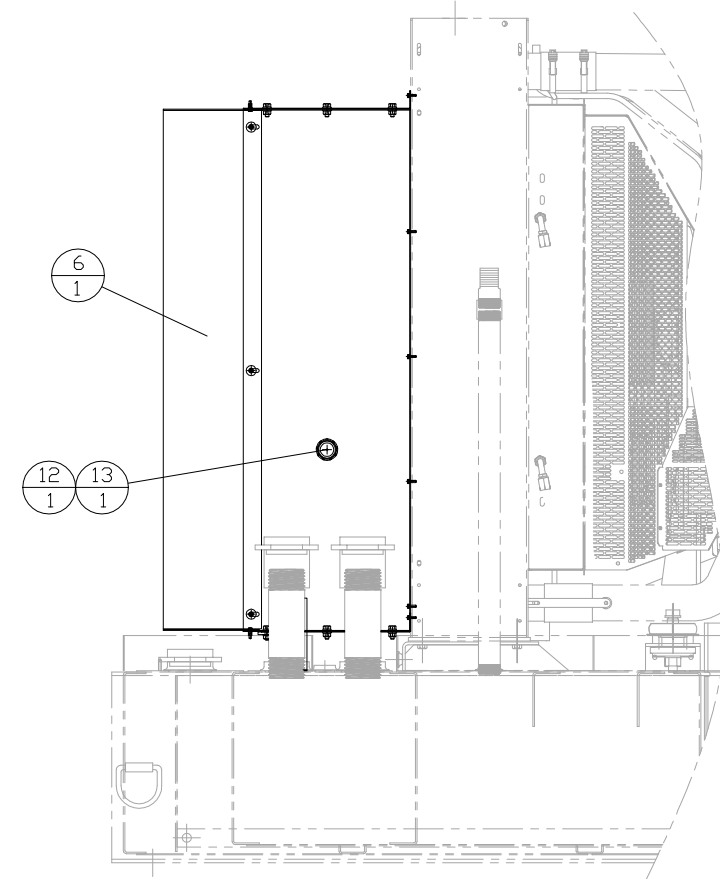

ALTORFER 6315 W. FAUBER RD. BARTONVILLE, IL 61607 PHONE (309) 697-1234 FAX (309) 282-7546	
07/12/13 BML DATE BY	THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF ALTORFER, INC. WITHOUT THE WRITTEN PERMISSION OF ALTORFER, INC., ANY COPYING OR OTHER USE EXCEPT THAT FOR WHICH IT WAS INTENDED IS PROHIBITED.
ALL DIMENSIONS IN INCHES UNLESS OTHERWISE SPECIFIED	FILE DF/87A PROJECT REFERENCE AMP500 RENTAL PACKAGE
TOLERANCES: .XX ± 0.100 .XXX ± 0.050 .XXXX ± 0.005	SCALE/SHEET SIZE 1=15/C DRAWN BY BML QUOTE NUMBER 0
ANGULAR ± 1°	SHEET 1 OF 1 DATE 05/15/13 WORK ORDER NUMBER 0
ADDED STIFFENER CHANGE NOTICE NO. 1	TITLE MOUNTING GROUP - DISCHARGE DUCT DRAWING NUMBER 87A210-1